

TRI-COUNTY RURAL ELECTRIC COOPERATIVE, INC

5 DAMASCUS STREET
COUDERSPORT, PENNSYLVANIA 16915
(814) 274 - 8740

P.O. BOX 134, 33 AUSTIN STREET
WELLSBORO, PENNSYLVANIA 16901
(570) 724 - 6712


22 NORTH MAIN STREET
MANSFIELD, PENNSYLVANIA 16933
(570) 662 - 2175
1 (800) 343 - 2559

INSTALLATION REQUIREMENTS FOR OVERHEAD SERVICE TO A PERMANENT BUILDING

IMPORTANT :

ALL INSTALLATIONS MUST BE INSPECTED AND APPROVED BY A RECOGNIZED INSPECTION AGENCY BEFORE THE SERVICE CAN BE ENERGIZED.

ALL INSTALLATIONS TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE

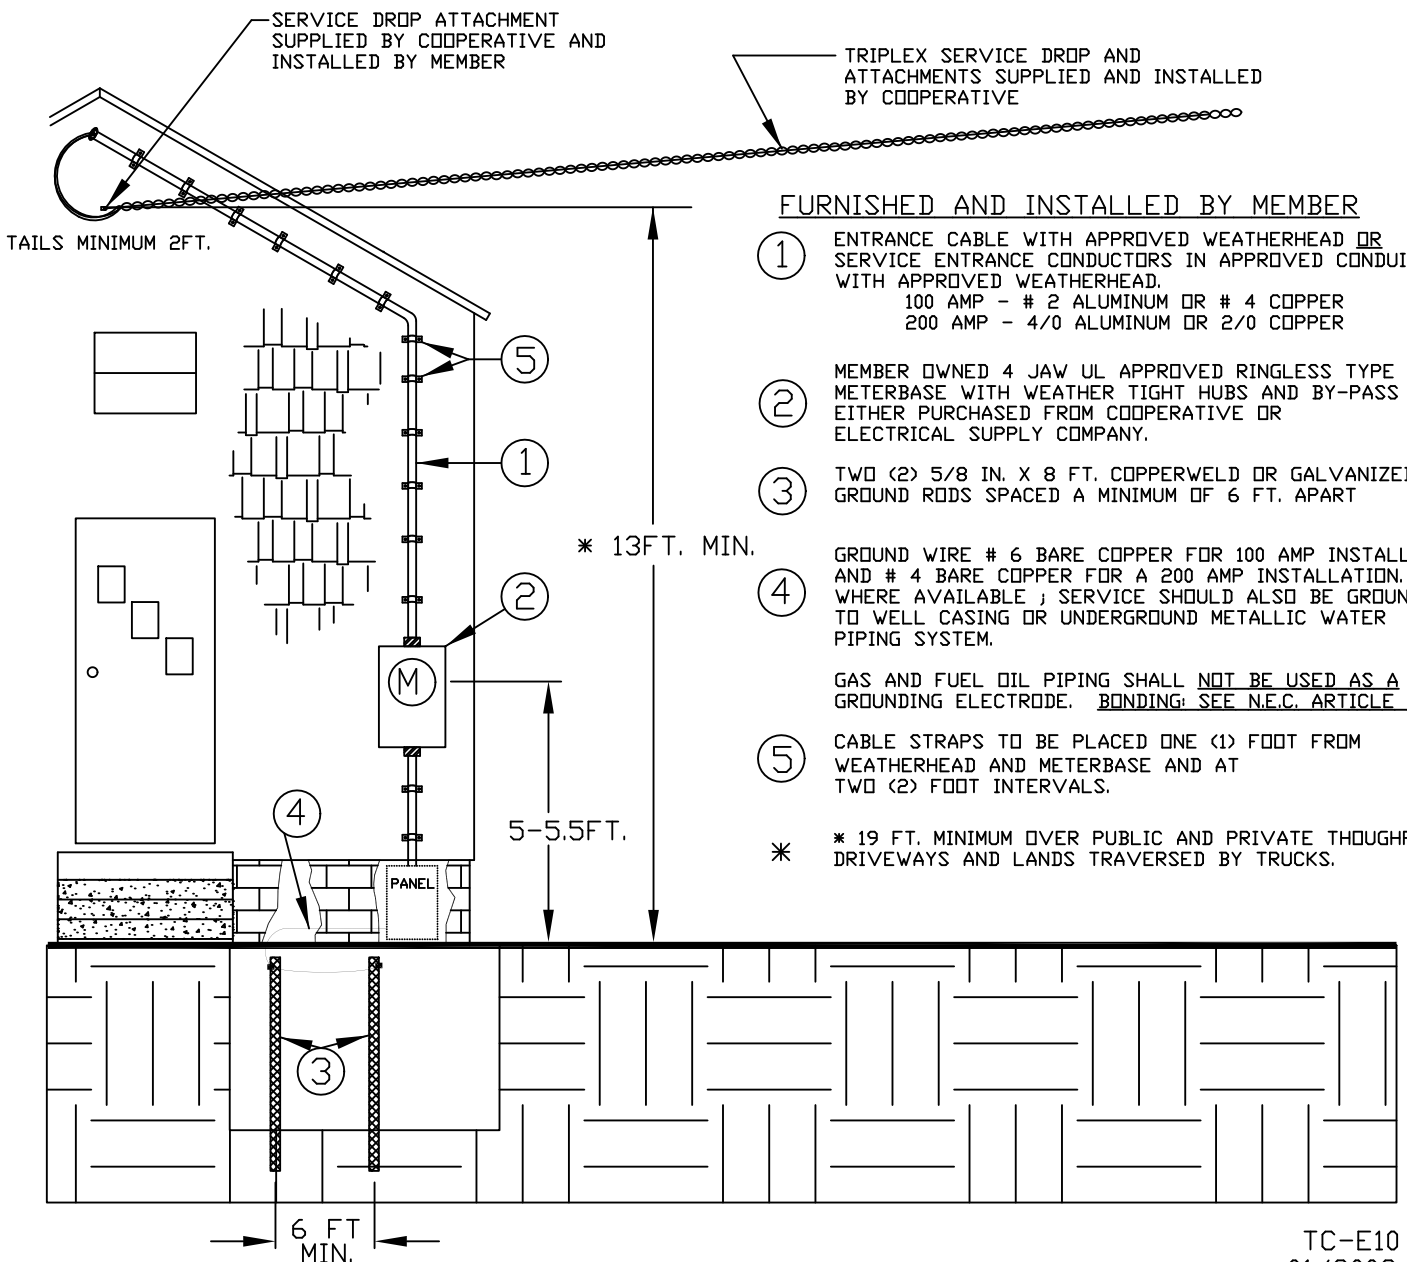

FURNISHED AND INSTALLED BY MEMBER

- ① ENTRANCE CABLE WITH APPROVED WEATHERHEAD OR SERVICE ENTRANCE CONDUCTORS IN APPROVED CONDUIT WITH APPROVED WEATHERHEAD.
100 AMP - # 2 ALUMINUM OR # 4 COPPER
200 AMP - 4/0 ALUMINUM OR 2/0 COPPER
 - ② MEMBER OWNED 4 JAW UL APPROVED RINGLESS TYPE METERBASE WITH WEATHER TIGHT HUBS AND BY-PASS HORNS EITHER PURCHASED FROM COOPERATIVE OR ELECTRICAL SUPPLY COMPANY.
 - ③ TWO (2) 5/8 IN. X 8 FT. COPPERWELD OR GALVANIZED GROUND RODS SPACED A MINIMUM OF 6 FT. APART
 - ④ GROUND WIRE # 6 BARE COPPER FOR 100 AMP INSTALLATION AND # 4 BARE COPPER FOR A 200 AMP INSTALLATION. WHERE AVAILABLE ; SERVICE SHOULD ALSO BE GROUNDED TO WELL CASING OR UNDERGROUND METALLIC WATER PIPING SYSTEM.
 - ⑤ GAS AND FUEL OIL PIPING SHALL NOT BE USED AS A GROUNDING ELECTRODE. BONDING: SEE N.E.C. ARTICLE 250
 - ⑤ CABLE STRAPS TO BE PLACED ONE (1) FOOT FROM WEATHERHEAD AND METERBASE AND AT TWO (2) FOOT INTERVALS.
- * * 19 FT. MINIMUM OVER PUBLIC AND PRIVATE THOUGHFARES, DRIVEWAYS AND LANDS TRAVERSED BY TRUCKS.